




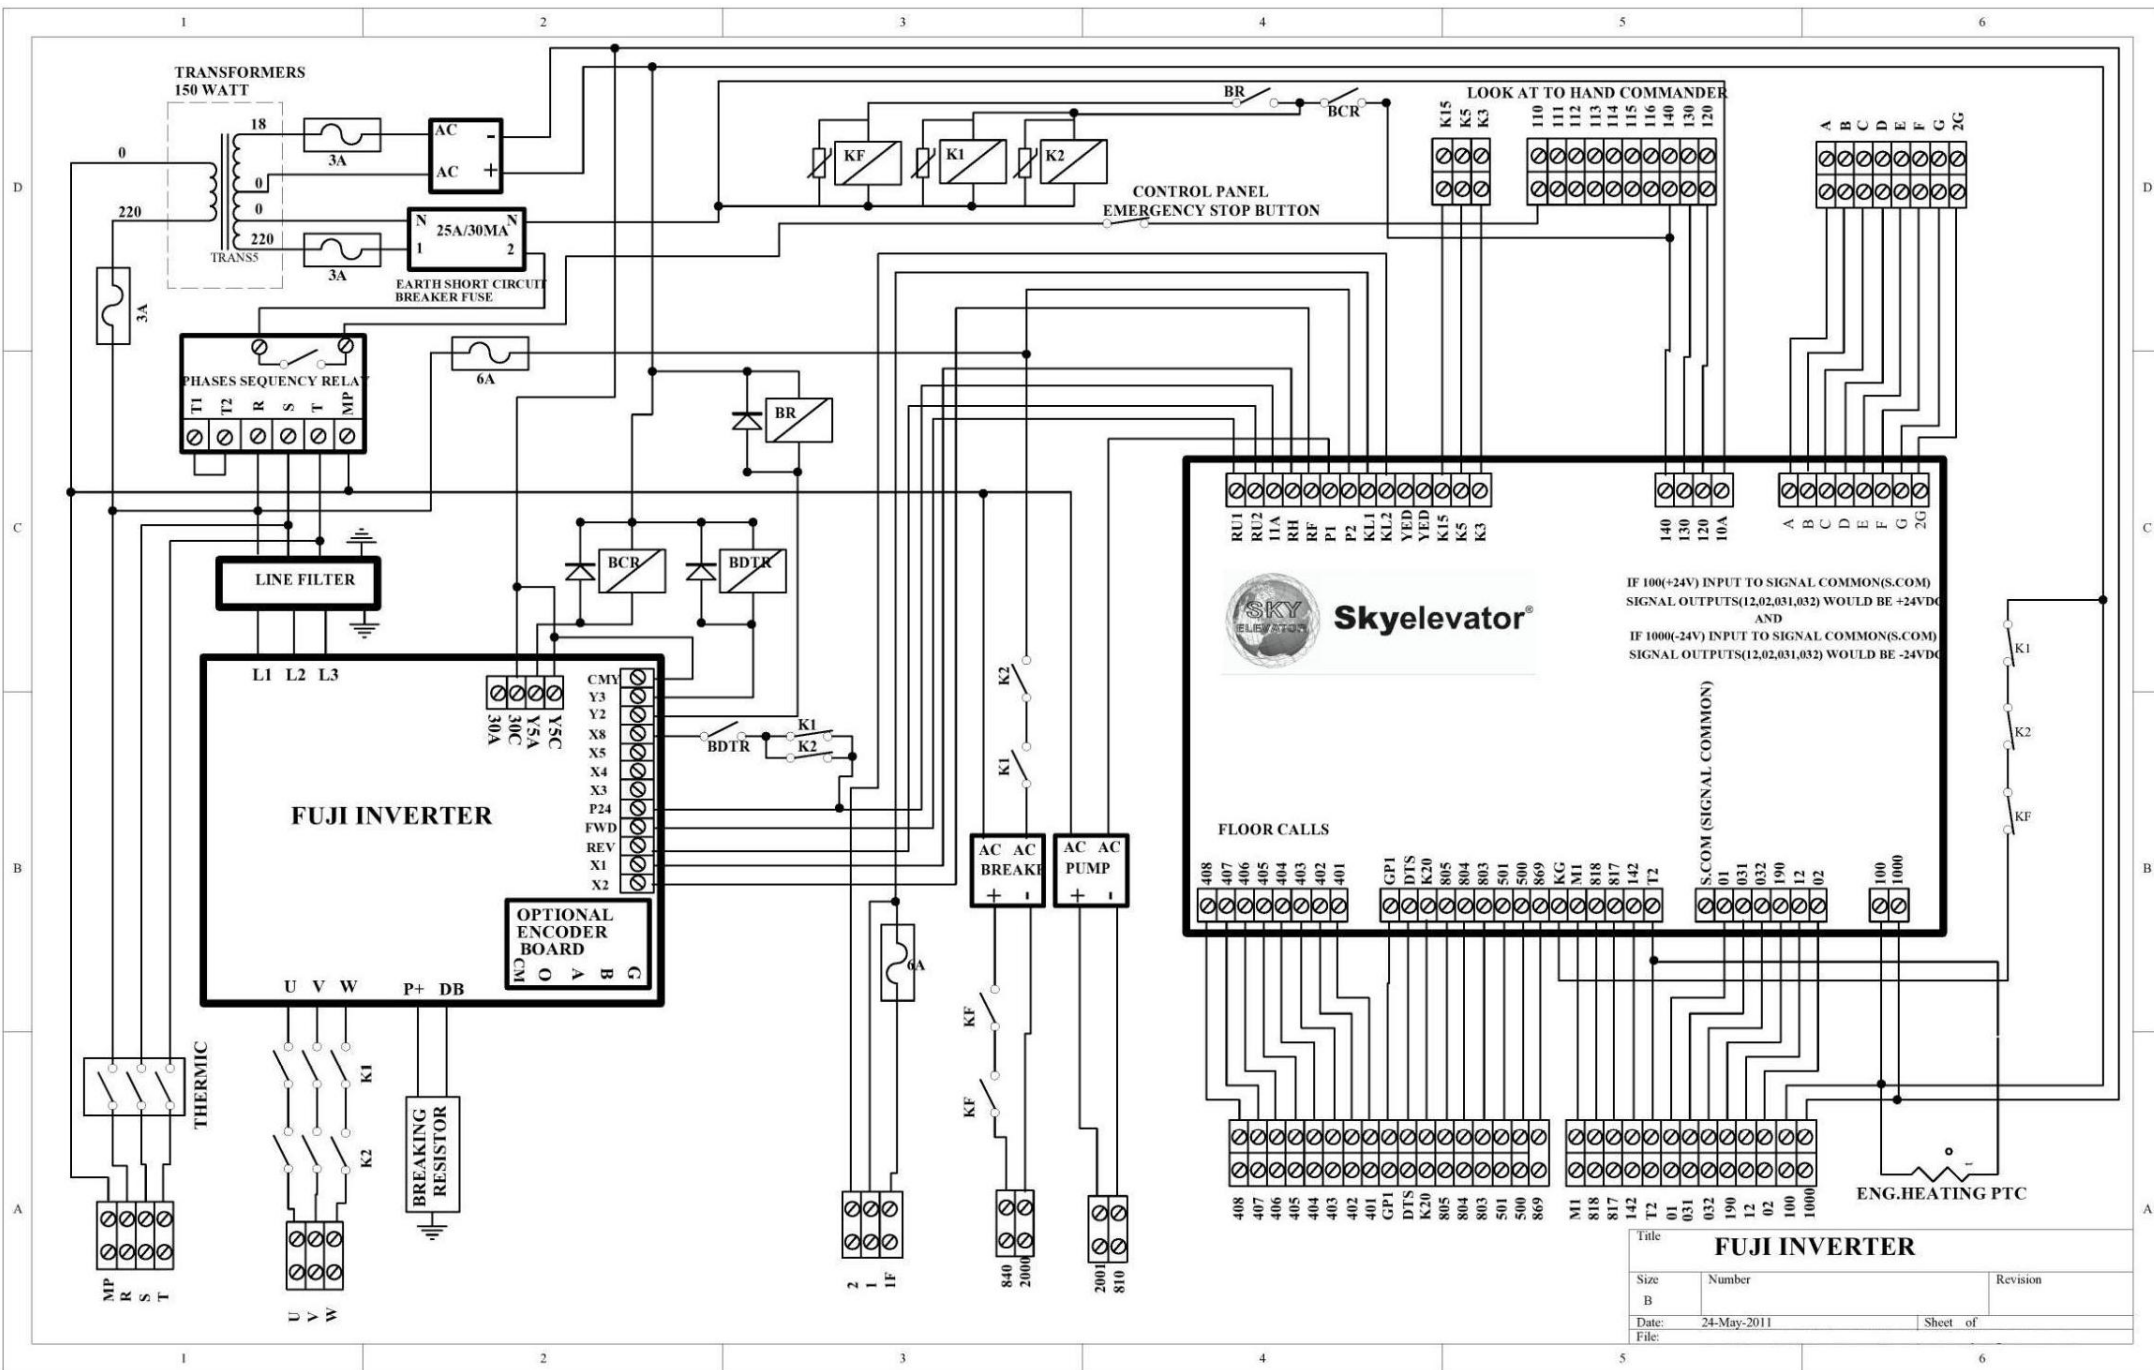

EMERGENCY ELECTRICAL OPERATOR SWITCH

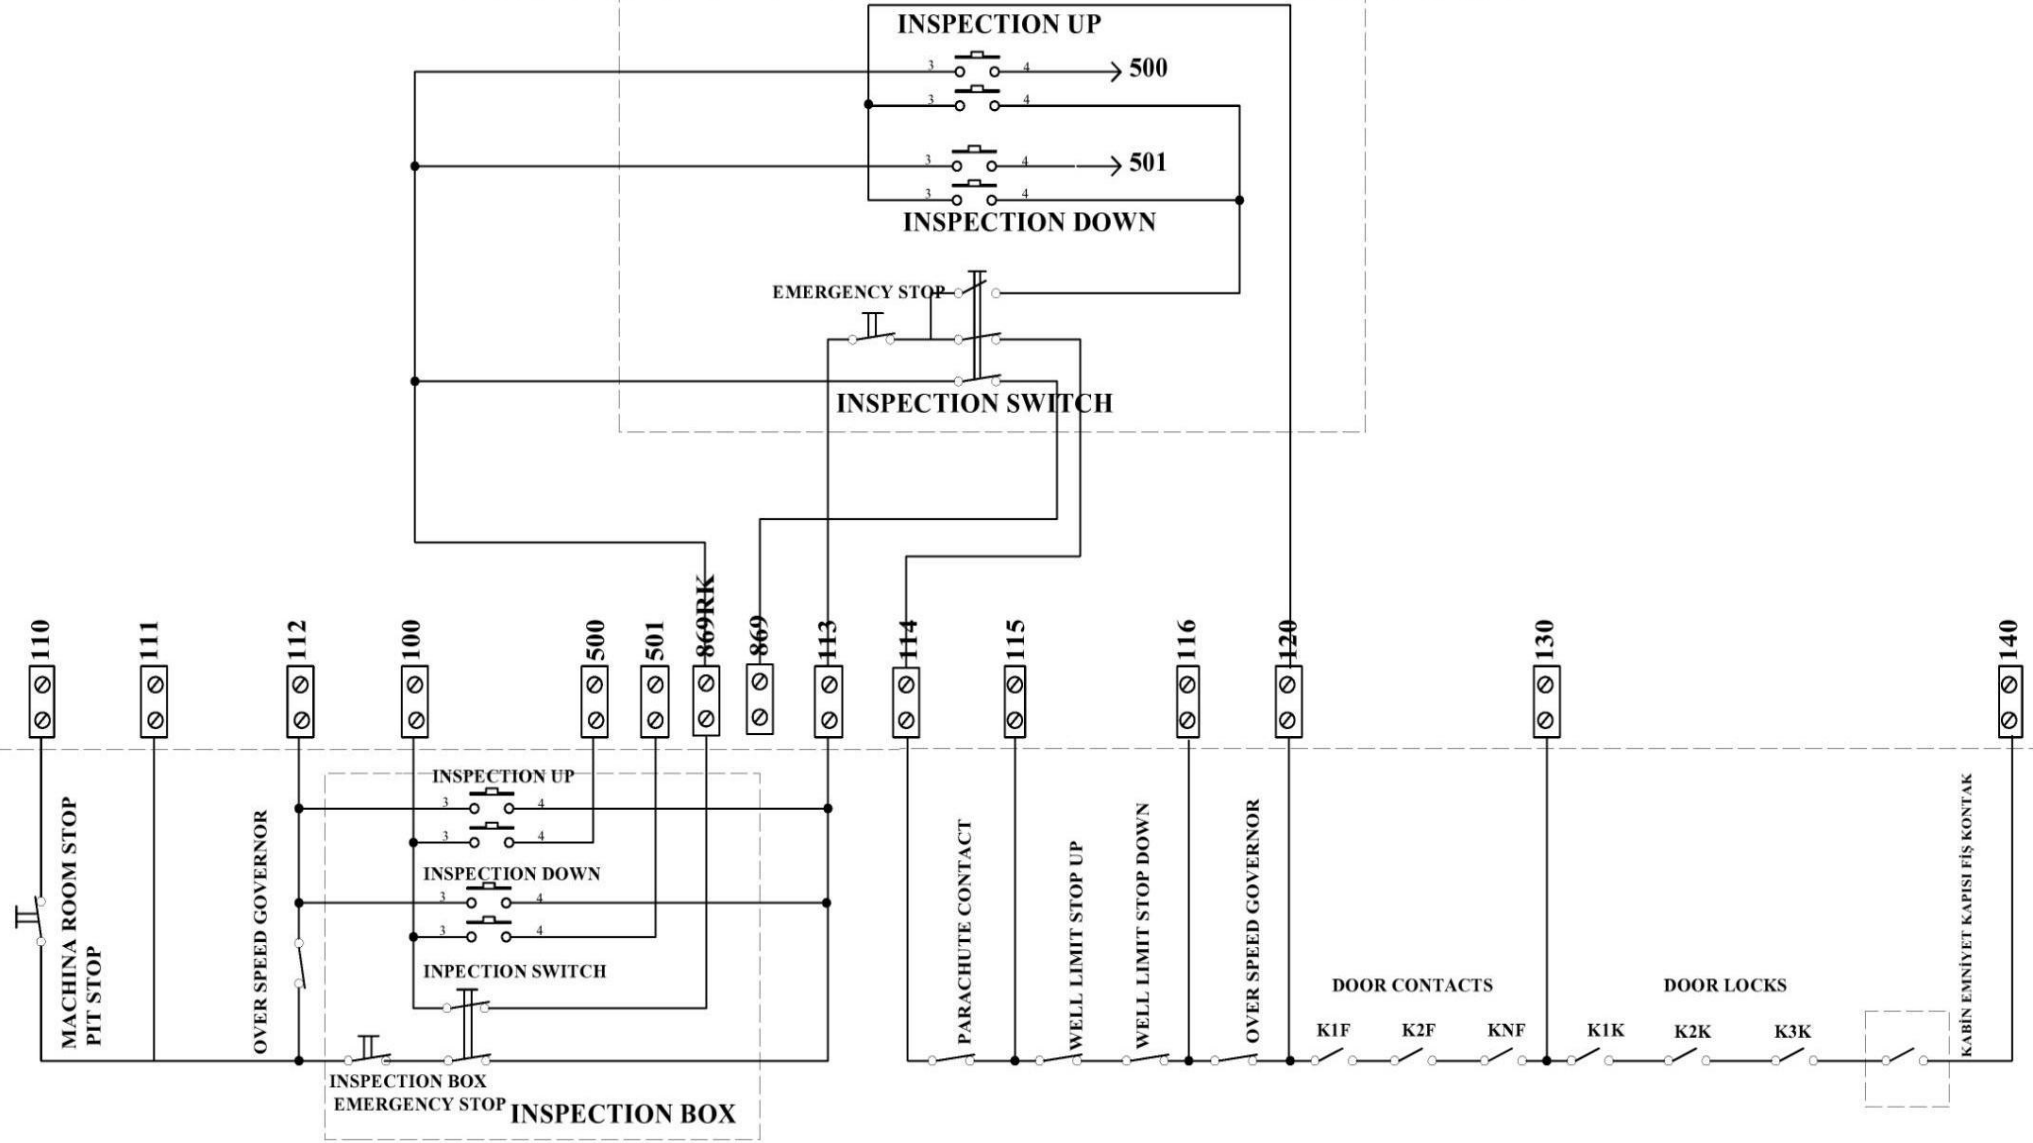

Title EMNİYET DEVRESİ VE GERİ ALMA TERMİNALİ		
Size B	Number	Revision
Date: 24-May-2011	Sheet of 301	Revision 1
File: D:\ERAY\NİHAİYET\PCB\Üretim\301\301Sema301.dbb	İng Sema301.dbb	

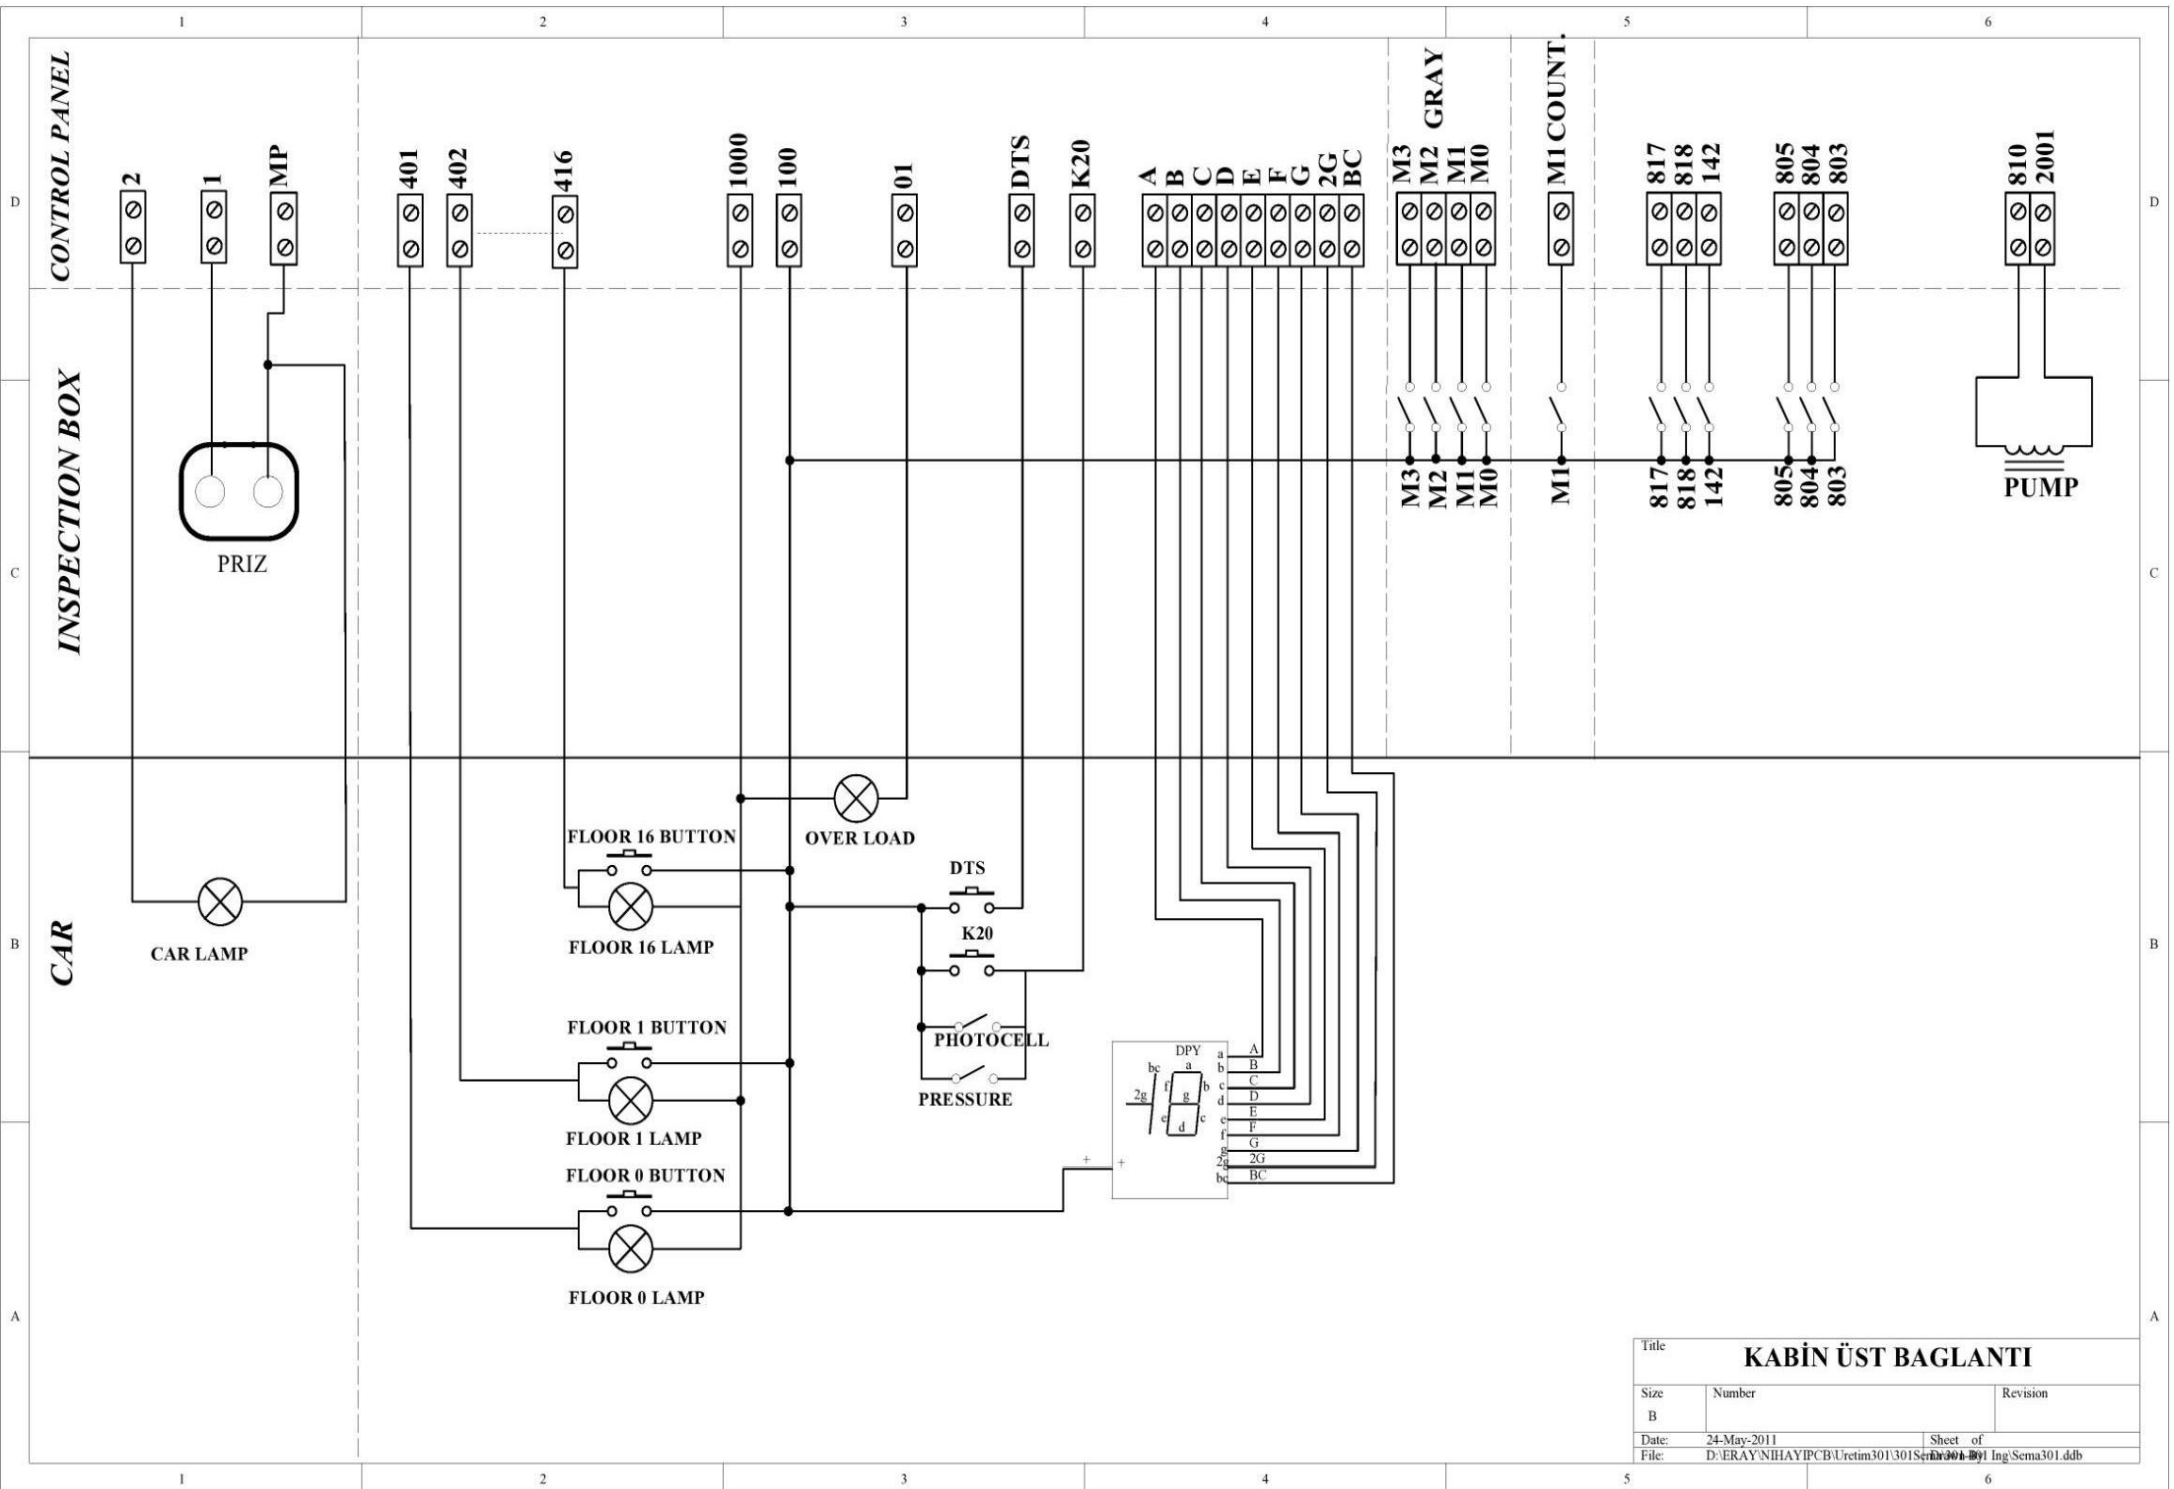


IF 100 (+24V) INPUT TO SIGNAL COMMON (S.COM) SIGNAL OUTPUT (12,02,031,032) WOULD BE(+24V) AND IF 1000 (-24V) INPUT TO SIGNAL COMMON (S.COM), SIGNAL OUTPUT(12,02,031,032) WOULD BE(-24V)	BASIC
--	-------

BASIC COMMAND


**MIXED
COLLECTIVE**

**DOWN / UP
COLLECTIVE**


DOUBLE BUTTON COLLECTIVE

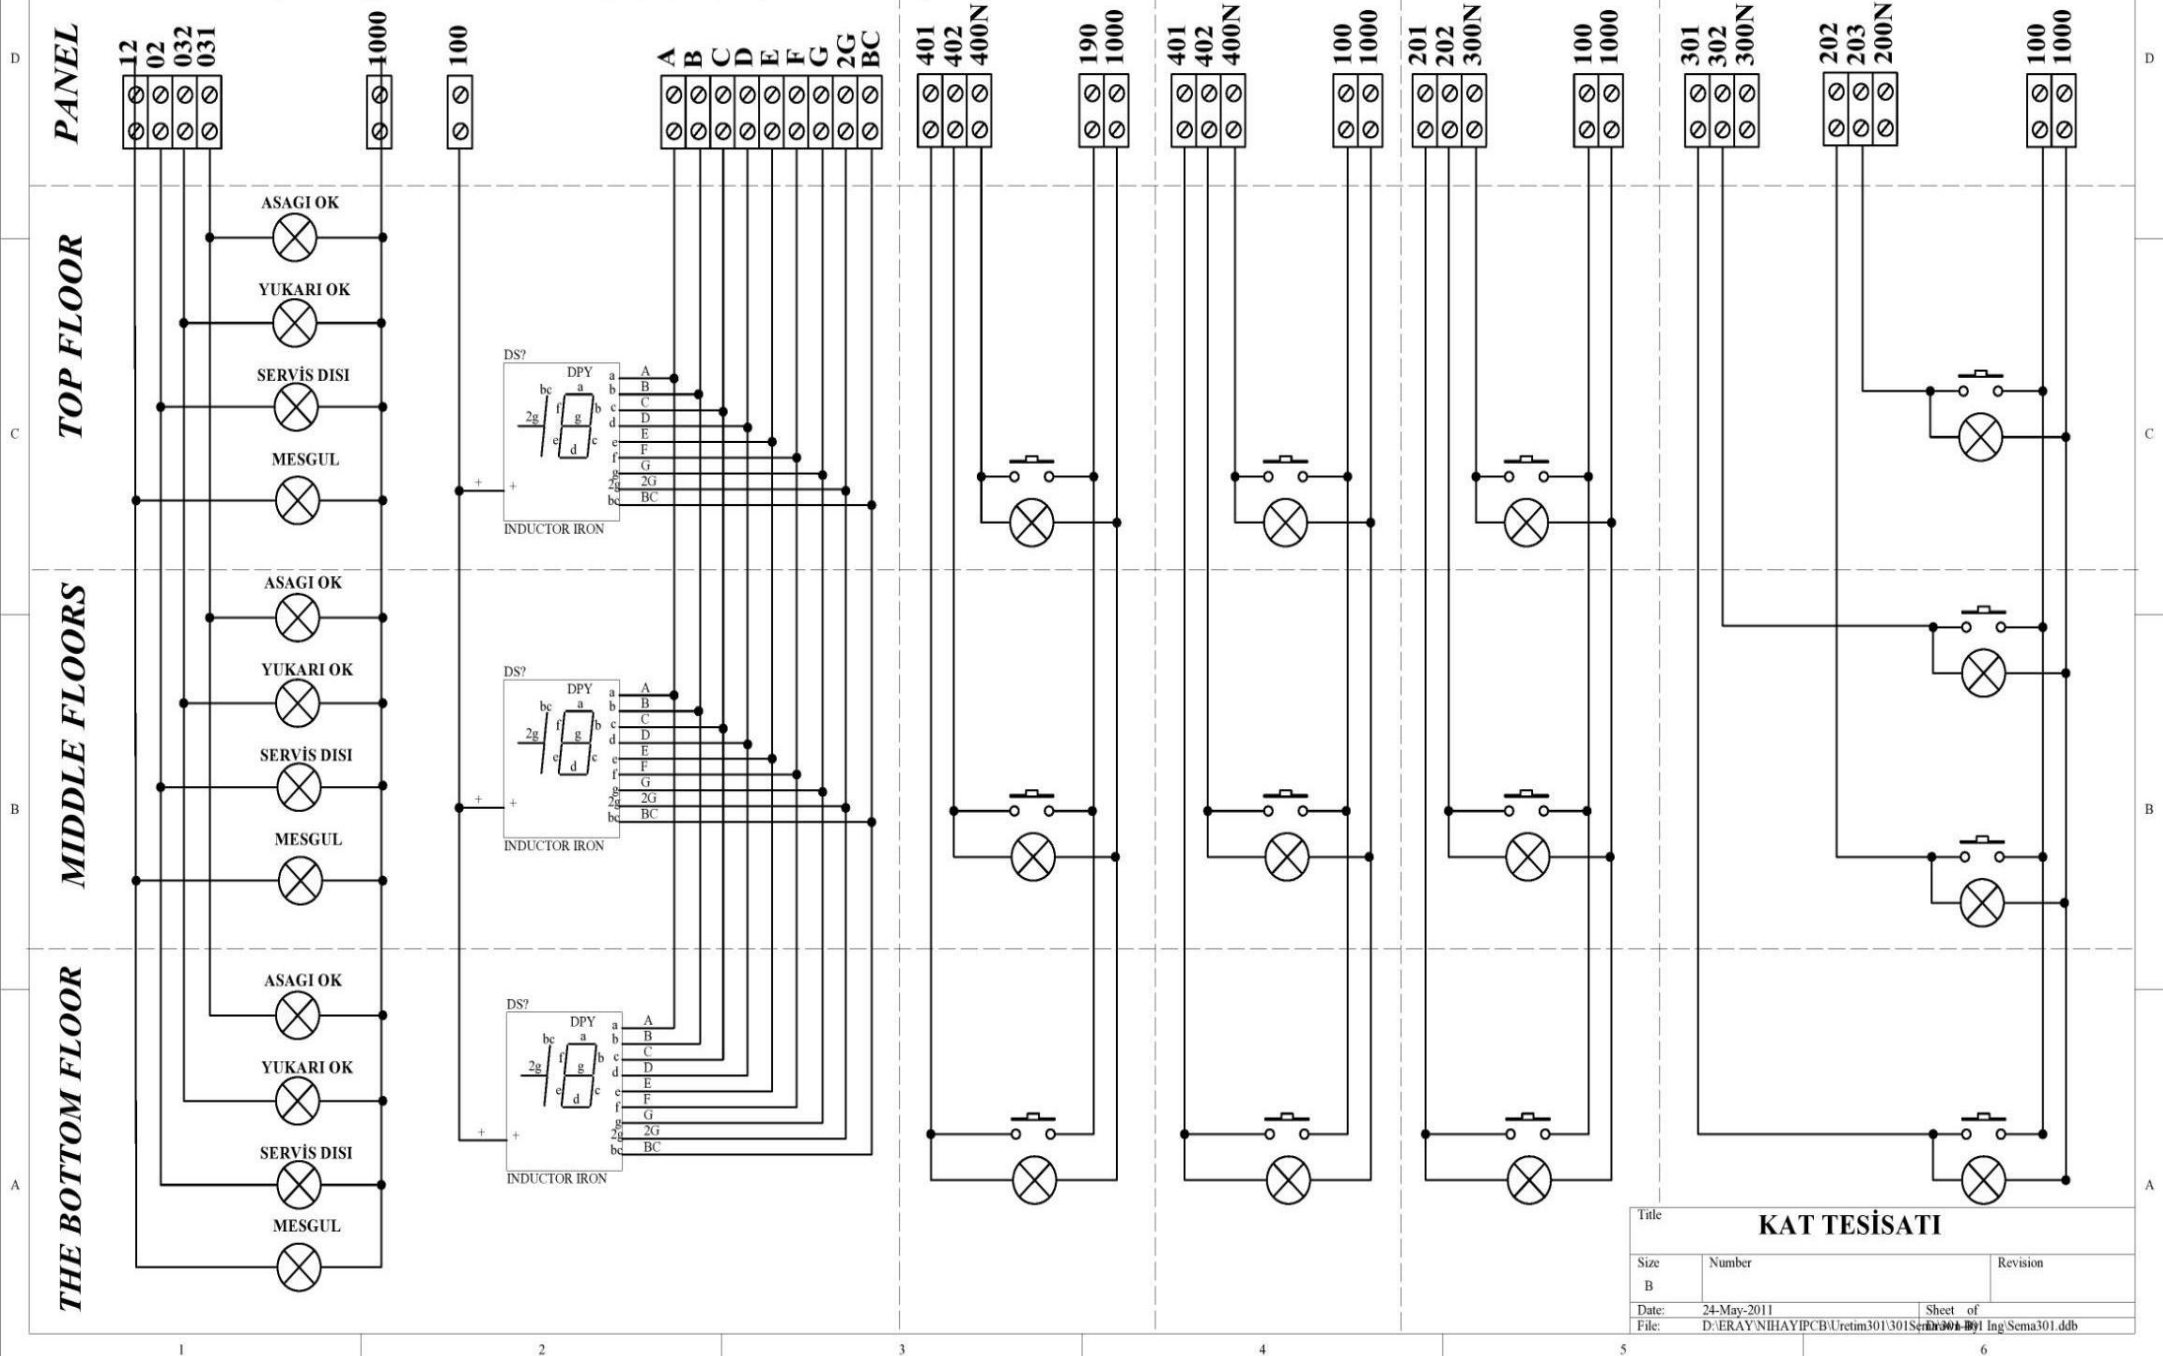

ONE PHASES DOOR

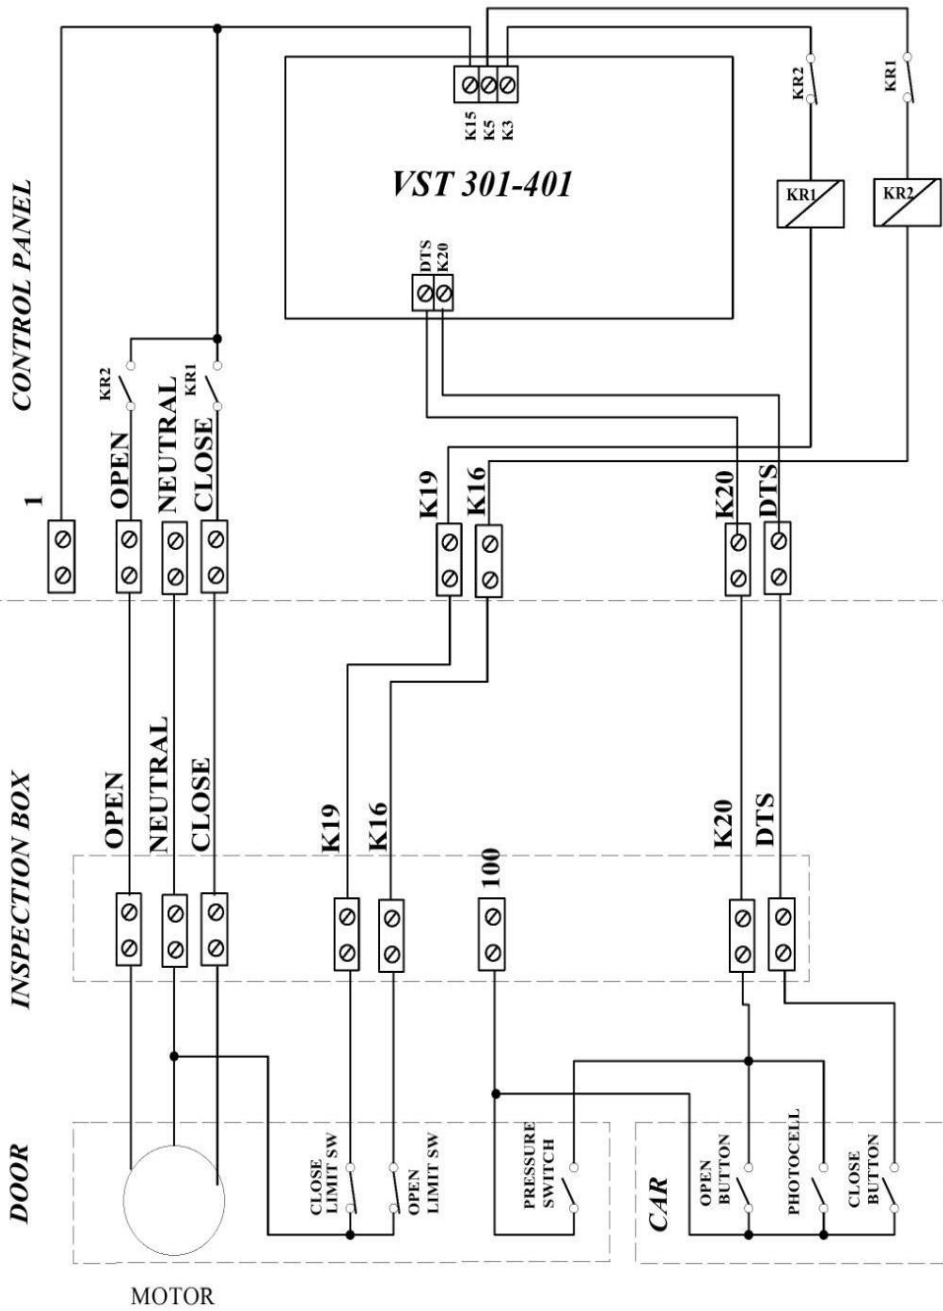

THEREE PHASES DOOR

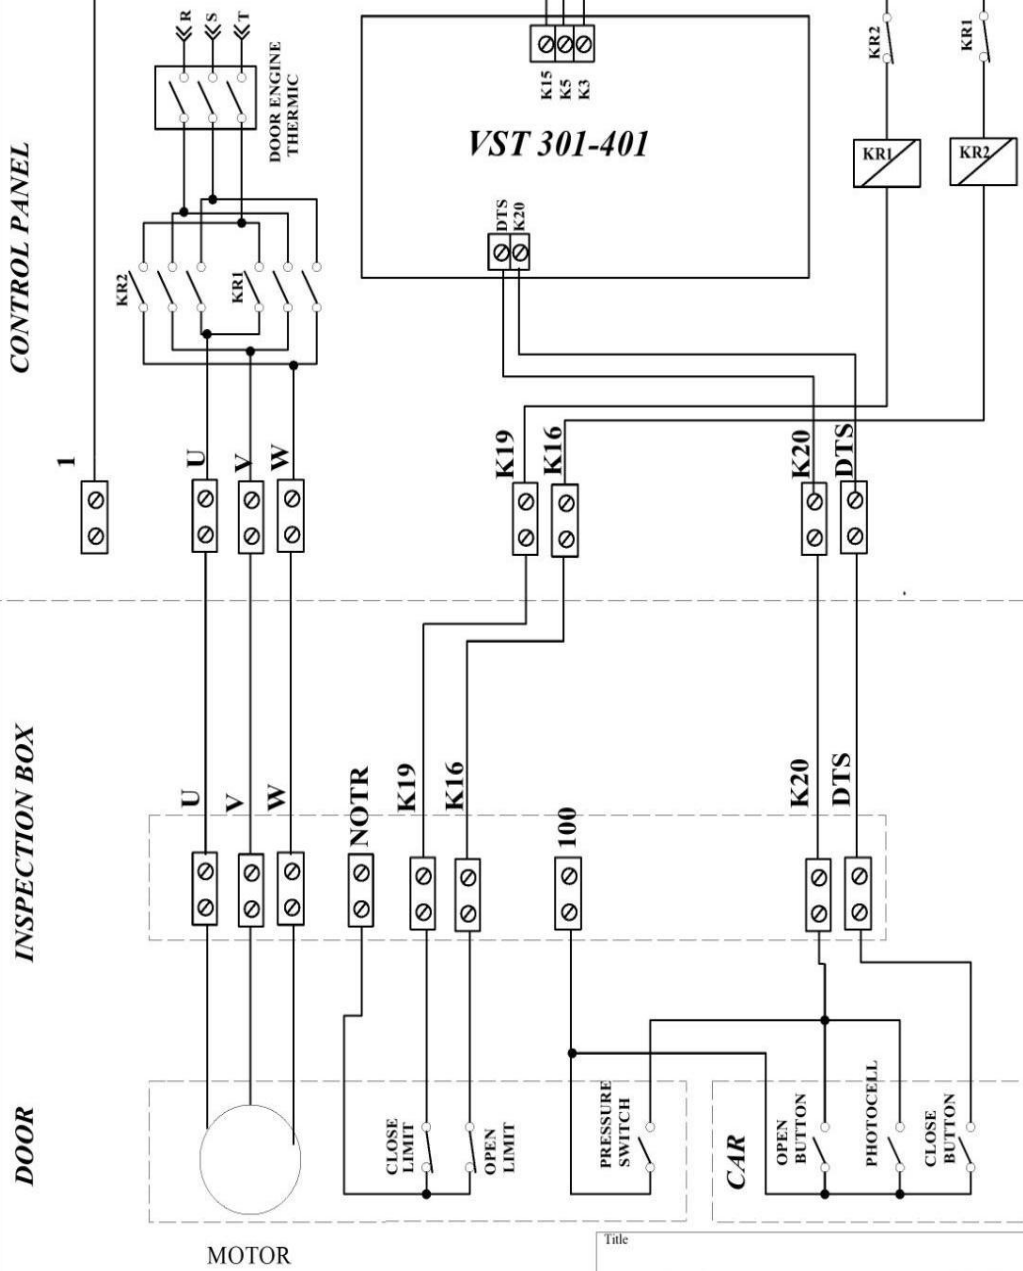

Title		
Size	Number	Revision
B		
Date:	24-May-2011	Sheet of
File:	D:\ERAY\NHAYIPCB\Uretim\301\301Sema301.ddb	301